





## AUTOMATIC MODE




OK?

### AUTOMATIC

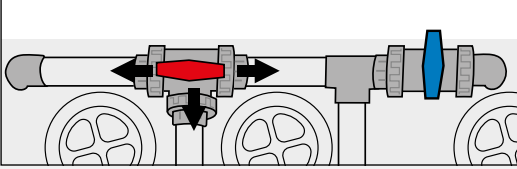

M o	1 5	: 3 1							
2	-	*	*	O U T	*	*	-	O N	
3	-	*	*	M A C	*	*	-	O F F	
4	-	*	*	A I R	*	*	-	O F F	
				9 L /	D A Y				
				6 D A Y S					

## DAILY CHECK




S u	1 9	: 1 8							
2	-	*	*	O U T	*	*	-	O F F	
3	-	*	*	M A C	*	*	-	O F F	
4	-	*	*	A I R	*	*	-	O N	
				I N S P E C T I O N					

## WEEKLY SERVICE



PUMP? MANUALLY ON -> SWITCH RIGHT -> MANUALLY OF

VALVE CHECK


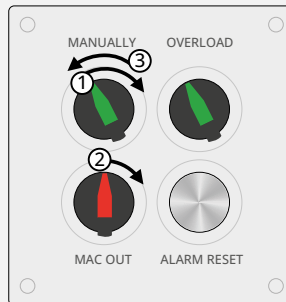


S u	1 9	: 1 3							
2	-	*	*	O U T	*	*	-	O F F	
3	-	*	*	M A C	*	*	-	O F F	
4	-	*	*	A I R	*	*	-	O N	
				P U M P					

### MAINTENANCE TANK 1

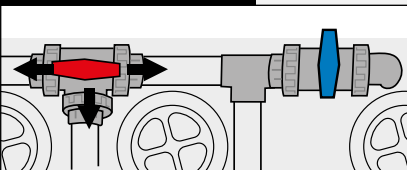


### MAINTENANCE TANK 2

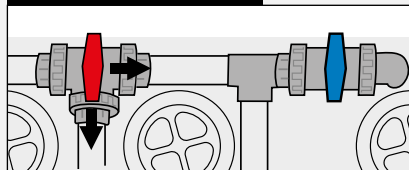

Each Tank must be recirculated ca. 30 seconds (MANUALLY + MAC or press button on PLC)

## BACTERIA

Throw a tablet into the toilet, flush it and press reset.



S u	1 9	: 1 7							
2	-	*	*	O U T	*	*	-	O F F	
3	-	*	*	M A C	*	*	-	O F F	
4	-	*	*	A I R	*	*	-	O N	
				B A C T E R I A					